



TEMPORARY SEDIMENT TRAP DESIGN CRITERIA	
DRAINAGE AREA (ACRES)	< 1 AC.
MIN. LENGTH TO WIDTH RATIO	2:1
MIN. VOLUME REQUIRED	3600 (CU. FT. PER AC. DISTURBED)
SURFACE AREA REQUIRED	435 (SQ. FT. PER CFS Q10)

CROSS-SECTION

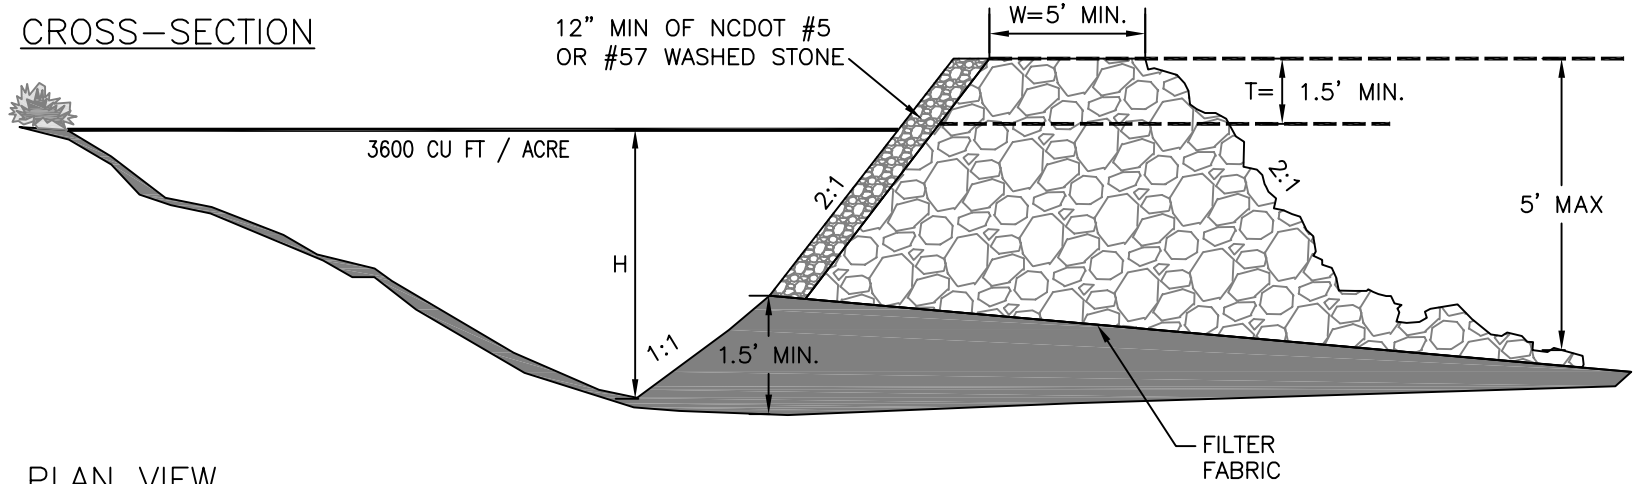

PLAN VIEW

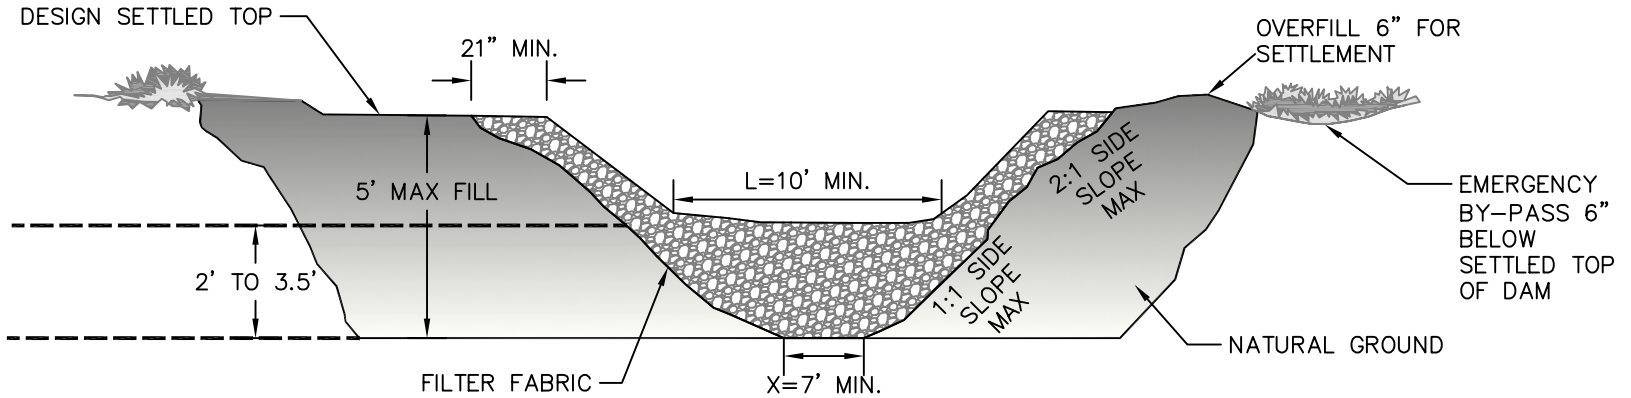

NOTE:

PLEASE REFER TO NCESCPDM SECTION #6.60 FOR ADDITIONAL DESIGN SPECIFICATIONS REGARDING TEMPORARY SEDIMENT TRAPS.

DATA BLOCK

TRAP NO.	DRAINAGE AREA (ACRES)	DENUDED AREA (ACRES)	Q ₁₀	TRAP VOLUME		TRAP SURFACE AREA		CLEANOUT DEPTH H/2 (FT.)	H (FEET)	L (FEET)	T (FEET)	W (FEET)	X (FEET)
				REQUIRED (C.F.)	PROVIDED (C.F.)	REQUIRED (C.F.)	PROVIDED (C.F.)						

NOT TO SCALE