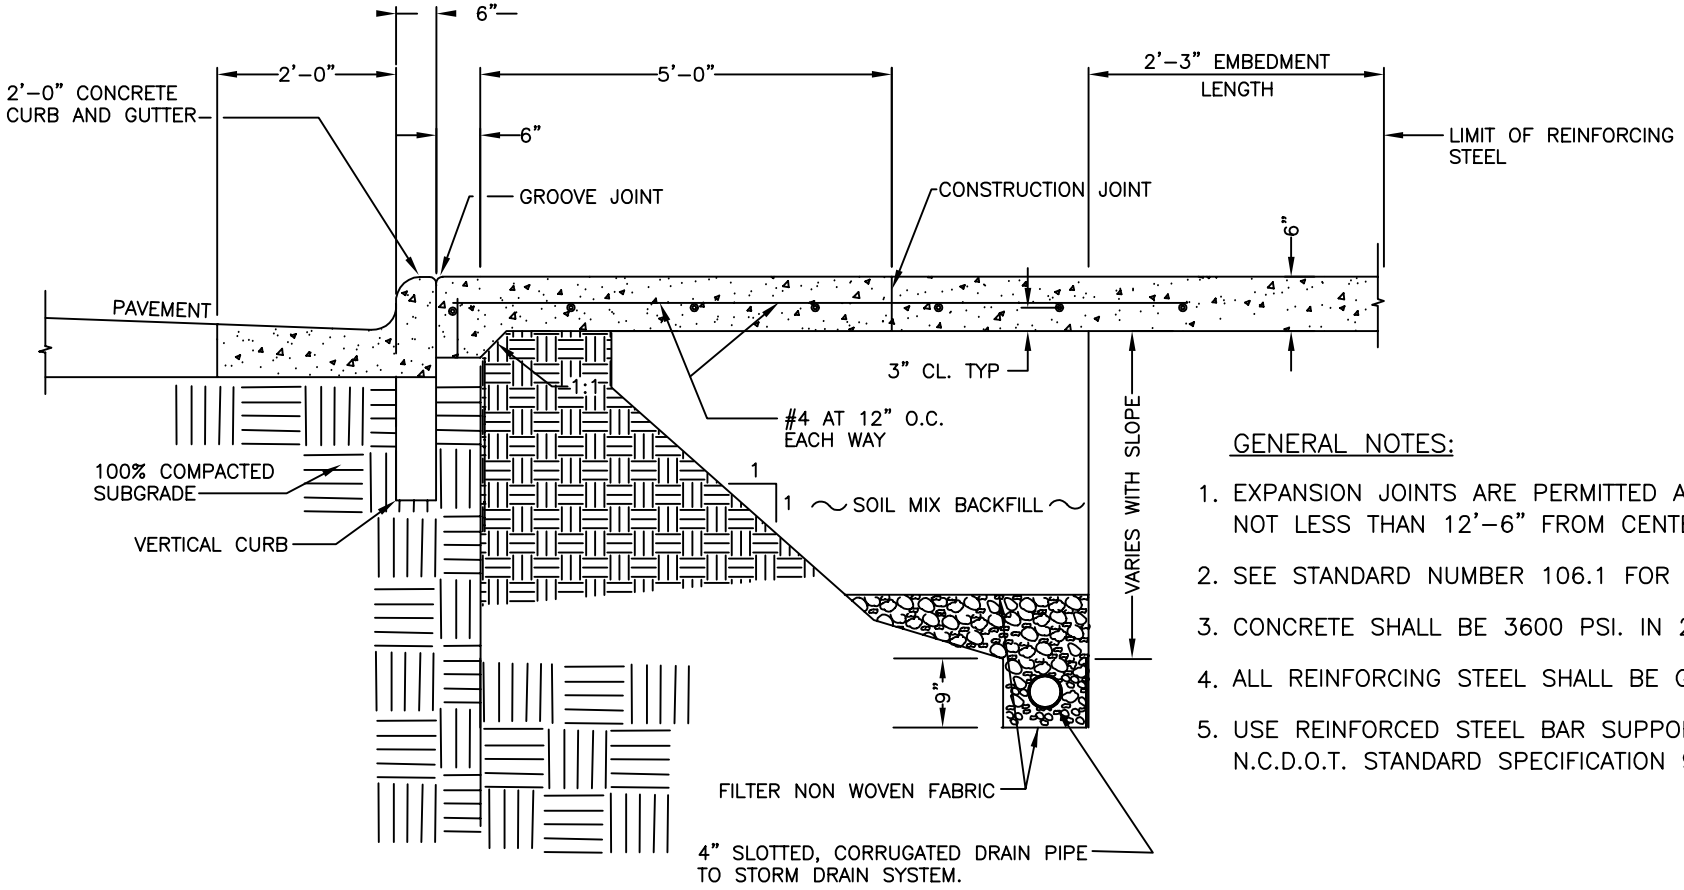

SECTION C

GENERAL NOTES:

1. EXPANSION JOINTS ARE PERMITTED AT 40' MIN. SPACING AND NOT LESS THAN 12'-6" FROM CENTER OF TREE GRATE.
2. SEE STANDARD NUMBER 106.1 FOR DETAIL OF GROOVE JOINT.
3. CONCRETE SHALL BE 3600 PSI. IN 28 DAYS.
4. ALL REINFORCING STEEL SHALL BE GRADE 60.
5. USE REINFORCED STEEL BAR SUPPORTS IN COMPLIANCE WITH N.C.D.O.T. STANDARD SPECIFICATION 970-4.

NOTE

A DRAINAGE SYSTEM IS REQUIRED AS SHOWN FOR ALL IRRIGATED PLANTING AREAS LOCATED ADJACENT TO STREET.

NOT TO SCALE

Town of Huntersville NORTH CAROLINA

STANDARD DRAWING

TREE PIT WITH GRATE IN SIDEWALK (SECTION)

REV. DATE
10/01/15
STD. NO.
605.1